


-15kV TOF: -9116 v  
 -3.6kV MCP: -2593 v  
 -2.4kV MCP: -1579 v  
 Input Cur: 302 ma  
 RPA max: 237 v  
 Mirror max: 238 v

Mon Sep 25 10:49:34 2006

## TIDE Direct Events

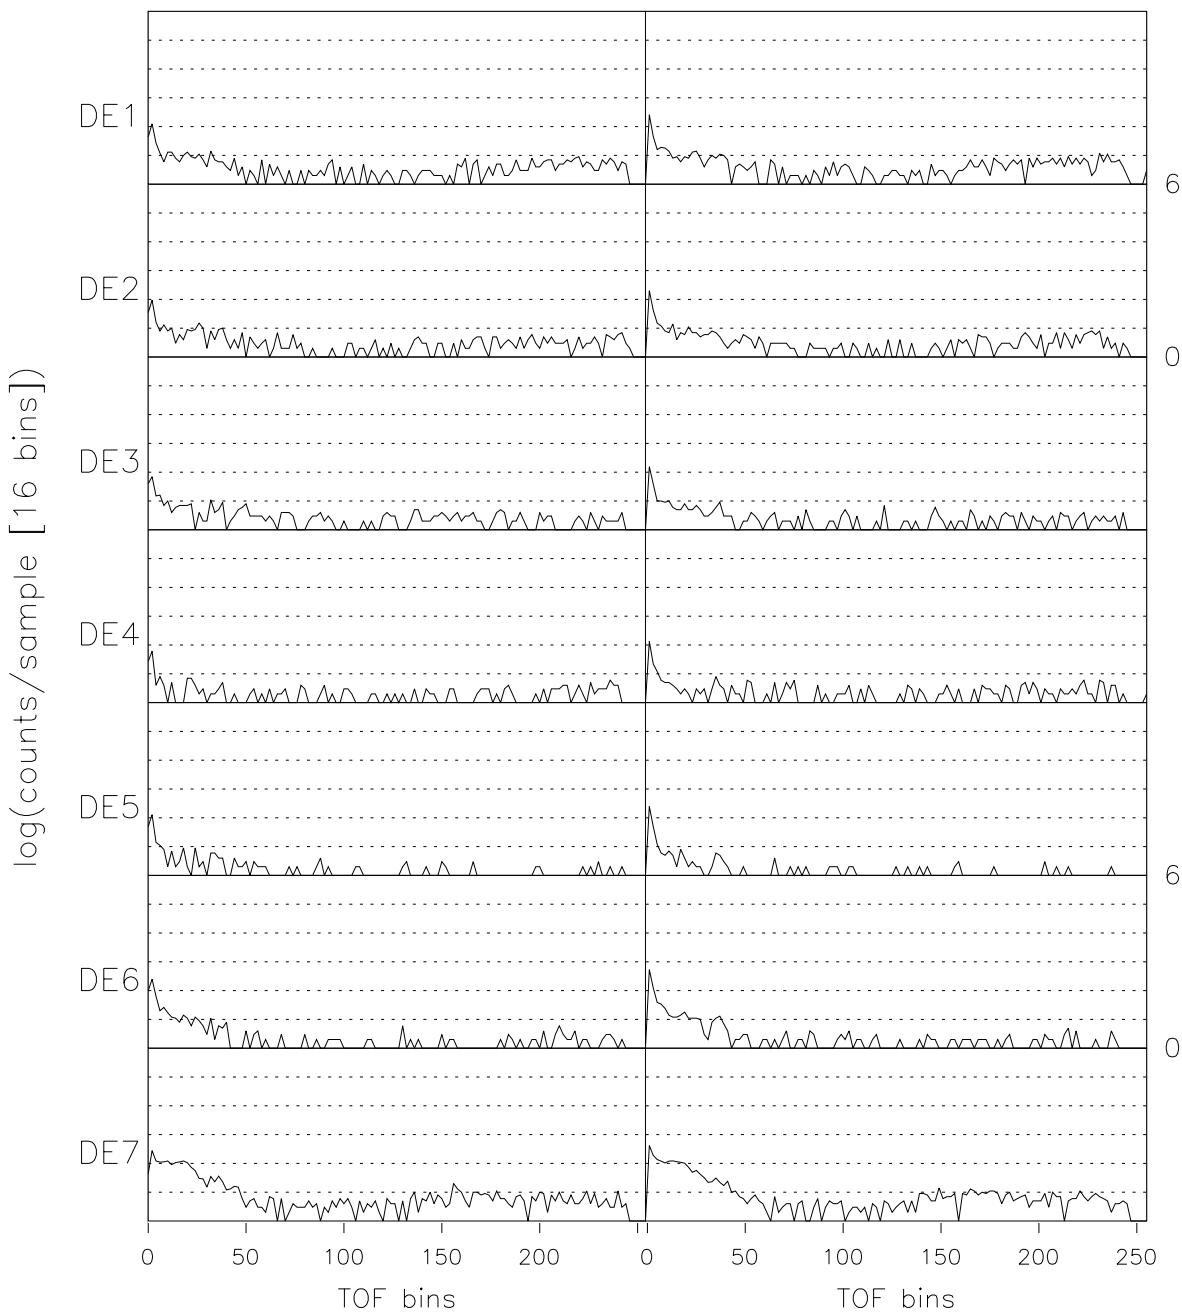

reported: 09-03-96 16:23:05 UT

reported: 09-03-96 16:26:18 UT

file: /export/data/tide/nrt/96090301.dat

-15kV TOF: -9245 v  
-3.6kV MCP: -2593 v  
-2.4kV MCP: -1579 v  
Input Cur: 302 ma  
RPA max: 237 v  
Mirror max: 238 v